VIRON® INTERNATIONAL CORP.
OWOSSO, MICHIGAN TEMPLE, TEXAS
989-723-8255
989-723-8417 FAX EMAIL: vironinfo@vironintl.com
ENVIRONMENTAL CONTROL SYSTEMS

| USER | |
|---|---|
| REP. | |
| JOB NO. | |
| DATE | SHEET OF |
| DRAWN BY | |

# PVC

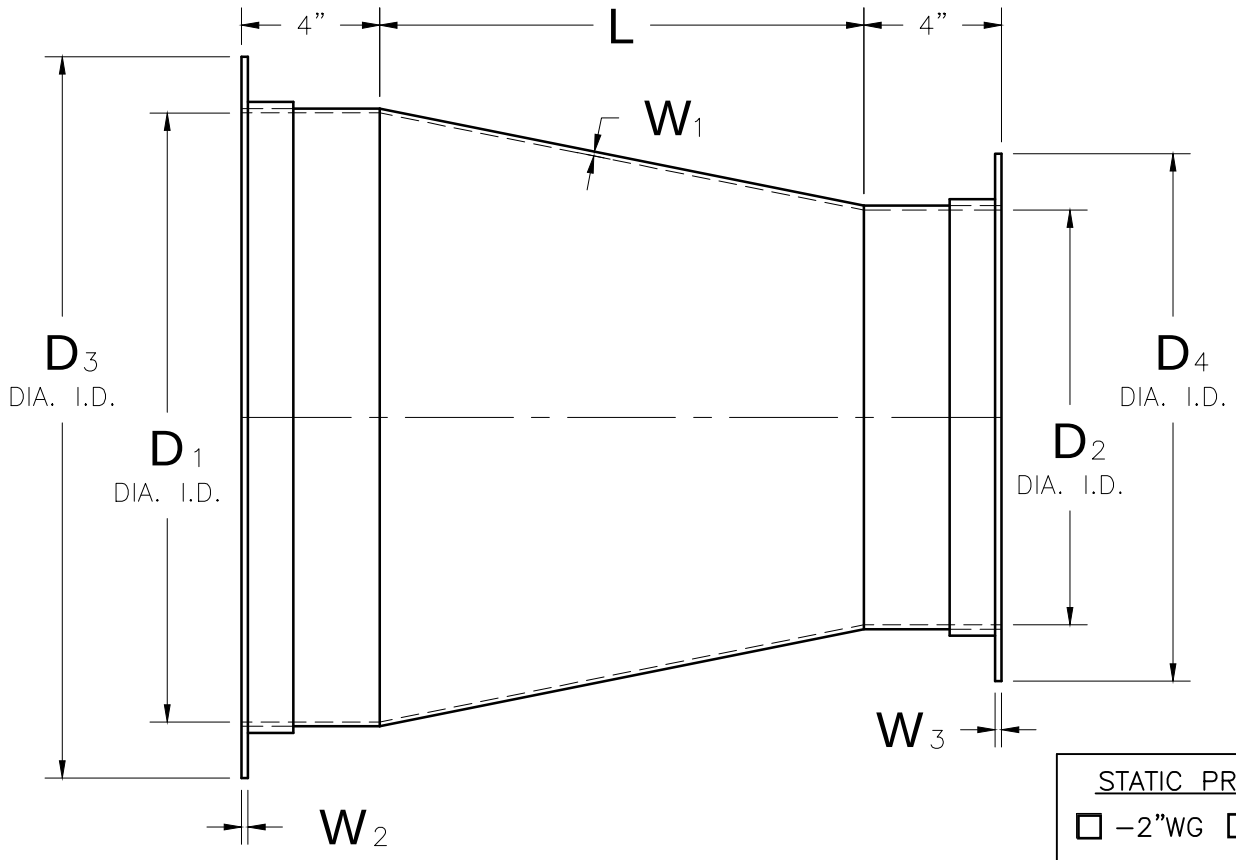


STATIC PRESSURE
☐ −2"WG ☐ −4"WG
☐ −6"WG ☐ −10"WG
OTHER: _____

| PART NO. | DESCRIPTION | | | | | | | | TYPE | QTY | REMARKS |
|---|---|---|---|---|---|---|---|---|---|---|---|
| | $D_1$ | $D_2$ | L | $W_1$ | $D_3$ | $W_2$ | $D_4$ | $W_3$ | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |
| | | | | | | | | | | | |

# PVC TAPER + (2) STRAIGHTS & FLANGES